



Conductivity meter, ELEMENT design

- Perfect for clean water and slightly concentrated liquids
- Compact measurement device for direct connection to PLC
- Thanks to a removable display/configuration module, parameterisation, calibration and transfer of parameterisation data
- Simulation of process values for diagnostics
- Universal process connection, three cell constants to cover a wide application range e.g. reverse osmosis

Product variants described in the data sheet may differ from the product presentation and description.

Can be combined with



Type 8611 ▶
eCONTROL - Universal controller



Type 8619 ▶
multiCELL - Multi-channel and multi-function transmitter/controller



Type 8693 ▶
Digital electropneumatic process controller for the integrated mounting on process control valves



Type 8802 ▶
ELEMENT continuous control valve systems - overview



Type S022 ▶
Insertion adaptor/fitting for ELEMENT analytical measurement devices

Type description

The Bürkert conductivity meter Type 8222 is designed for measuring the conductivity of fluids.

The sensor element, comprising a two-electrode cell and a Pt1000 temperature probe, is available with three different cell constants C. These with C=0.01 or 0.1 cm⁻¹ are fitted with stainless steel electrodes and those with C=1.0 cm⁻¹ are fitted with graphite electrodes.

Thus, due to the design of the measuring device, Bürkert simplifies installation and maintenance work.

The device Type 8222 is available in two version.

- The first one called ELEMENT standard is proposed either with three adjustable outputs (two digital outputs and one analogue output) or with four adjustable outputs (two digital outputs and two analogue outputs) and can be equipped with a display. The display is only required for start-up, configuration (e.g. selection of measuring range, units, calibration, limit values...) or as a process value display.
- The second called ELEMENT neutrino is a 2-wire device without display, with a 4...20 mA current output and is available with two types of pipe connections, either with a G 1½" union nut for mounting with an adaptor having a G 1½" external threaded sensor connection or with a G ¾" threaded holder to be screwed into an adaptor having a G ¾" internal thread sensor connection.

The Type 8222 converts the measuring signal, displays for the ELEMENT standard version various values in different measuring units (if display is mounted) and computes the output signals, which are provided for the ELEMENT standard version via one or two M12 plug-in connections or for the ELEMENT neutrino version via one M12 plug-in connection or on a terminal strip via a cable gland.

Table of contents

1. General Technical Data	3
1.1. About the device.....	3
1.2. All models	3
1.3. ELEMENT standard version.....	4
1.4. ELEMENT neutrino version.....	6
2. Approvals	7
2.1. Certification.....	7
2.2. Certificates.....	7
2.3. Pressure Equipment Directive.....	7
Device used on a pipe	7
Device used on a vessel	8
3. Materials	8
3.1. Chemical Resistance Chart – Bürkert resistApp.....	8
3.2. Material specifications	8
ELEMENT standard version.....	8
ELEMENT neutrino version.....	9
4. Dimensions	10
4.1. ELEMENT standard version.....	10
4.2. ELEMENT neutrino version.....	11
With a G 1½" union nut connection.....	11
With a G ¾" external threaded connection.....	11
5. Performance specifications	12
5.1. Pressure temperature diagram.....	12
ELEMENT standard and ELEMENT neutrino versions	12
ELEMENT standard and ELEMENT neutrino versions installed with an S022 adaptor.....	12
6. Product installation	13
6.1. Installation notes.....	13
7. Product operation	14
7.1. Measuring principle	14
8. Product design and assembly	15
8.1. Product assembly	15
9. Networking and combination with other Bürkert products	16
10. Ordering information	16
10.1. Bürkert eShop – Easy ordering and quick delivery.....	16
10.2. Recommendation regarding product selection	16
10.3. Bürkert product filter.....	17
10.4. Ordering chart.....	17
ELEMENT standard version.....	17
ELEMENT neutrino version.....	18
10.5. Ordering chart accessories.....	19

1. General Technical Data

1.1. About the device

The conductivity measurement device consists of a sensor available with three cell constants C plugged-in and pinned to the transmitter. The device is available in an ELEMENT standard version or in an ELEMENT neutrino version. Both are available with a G 1½" union nut process connection in PVC or PVDF. The ELEMENT neutrino version is also proposed with a holder with G ¾" process connection.

1.2. All models

Note:

- The following data applies to all versions.
- If the device is mounted in a humid environment or outside, then the maximum voltage allowed is **35 V DC** instead of 36 V DC.

Product properties

Material

Please make sure the device materials are compatible with the fluid you are using.

Detailed information can be found in chapter **"3.1. Chemical Resistance Chart – Bürkert resistApp"** on page 8 and in chapter **"3.2. Material specifications"** on page 8.

Non wetted parts

Housing Stainless steel 1.4404 (316L), PPS

Wetted parts

Probe holder PVDF, stainless steel 1.4571 (316Ti)

Electrode For cell constant:

- C = 0.01 cm⁻¹: stainless steel 1.4571 (316Ti)
- C = 0.1 cm⁻¹: stainless steel 1.4571 (316Ti)
- C = 1 cm⁻¹: graphite

Dimensions Detailed information can be found in chapter **"4. Dimensions"** on page 10.

Compatibility Any pipe which is fitted with Bürkert S022 adaptor. See **data sheet Type S022** ▶ for more information.

Pipe diameter DN 25...DN 110 (DN 15...DN 20 under specific conditions)

Probe With cell constant

- C = 0.01 cm⁻¹
- C = 0.1 cm⁻¹
- C = 1 cm⁻¹

Temperature sensor Pt1000 integrated within the holder

Measuring range

- Conductivity measurement: 0.05 µS/cm...10 mS/cm
- Temperature measurement: -20...+100 °C (-4...+212 °F)

Performance data

Measurement deviation

- Conductivity measurement: ±3 % of measured value
- Temperature measurement: ±1 °C (1.8 °F)

4...20 mA output uncertainty ±1 % of range

Electrical data

Power source (not supplied) Limited power source according to UL/EN 60950-1 standards or limited energy circuit according to UL/EN 61010-1 §9.4

DC reverse polarity protection Yes

Overvoltage protection Yes

Voltage supply cable Shielded cable

Medium data

Fluid temperature	Device with <ul style="list-style-type: none"> • G 1½" PVC union nut connection: 0...+50 °C (+32...+122 °F) • G 1½" PVDF union nut connection (on request for ELEMENT neutrino version): -20...+100 °C (-4...+212 °F) restricted by the used adaptor Restriction with adaptor S022 in: <ul style="list-style-type: none"> – PVC: 0...+50 °C (+32...+122 °F) – PP: 0...+80 °C (+32...+176 °F) – Metal: -20...+100 °C (-4...+212 °F)
Fluid pressure ^{1.)}	Max. PN 16 (232 PSI) Detailed information can be found in chapter "5.1. Pressure temperature diagram" on page 12 (depends on selected probe).

Process/Port connection & communication

Process connection	G 1½" internal thread for use with Type S022 adaptor See data sheet Type S022 ▶ for more information.
--------------------	---

Approvals and certificates**Directives**

CE directives	The applied standards, which verify conformity with the EU Directives, can be found on the EU Type Examination Certificate and/or the EU Declaration of conformity (if applicable)
Pressure equipment directives	Complying with Article 4, Paragraph 1 of 2014/68/EU directive Detailed information on the pressure equipment directive can be found in chapter "2.3. Pressure Equipment Directive" on page 7.
Certification	<ul style="list-style-type: none"> • UL-Recognized for US and Canada • Certificate of sanitary conformity (ACS)

Environment and installation

Ambient temperature	Operation and storage: -10...+60 °C (+14...+140 °F)
Relative air humidity	≤ 85 %, without condensation
Height above sea level	Max. 2000 m
Operating condition	Continuous
Equipment mobility	Fixed
Application range	Indoor and outdoor (protect the device against electromagnetic interference, ultraviolet rays and against the effects of climatic conditions)
Installation category	Category I according to UL/EN 61010-1
Pollution degree	Degree 2 according to UL/EN 61010-1

1.) Not evaluated by UL

1.3. ELEMENT standard version**Product properties****Material**

Detailed information on the materials can be found in chapter **"3.2. Material specifications"** on page 8.

Non wetted parts

Cover	Polycarbonate (PC), transparent (opaque on request)
Display/configuration module	PC
Navigation key	PBT
Seals	EPDM, silicone
Screws	Stainless steel 1.4401 (316 (A4))
Fixed connector holder	PPS CF30
Fixed connector	Nickel-plated brass
Grounding terminal and screw	Stainless steel 1.4301 (304 (A2))
Nut	PVC or PVDF

Temperature compensation	<ul style="list-style-type: none"> • None or • According to a predefined graph <ul style="list-style-type: none"> – Linear or – NaCl or – Ultra pure water or • According to a graph defined especially for your process
Concentration	Conversion of conductivity to dissolved electrolyte concentration (Total dissolved solids (TDS)) by using a user adjustable factor.
Product accessories	
Display/configuration module	Grey dot matrix 128 x 64 with backlighting
Performance data	
Measuring range resolution	<ul style="list-style-type: none"> • Conductivity measurement: 1 nS/cm • Temperature measurement: 0.1 °C (0.18 °F)
Minimal scale range	Temperature measurement: 10 °C (i.e. +10...+20 °C (+50...+68 °F) corresponding to 4...20 mA)
Electrical data	
Operating voltage	<ul style="list-style-type: none"> • 3 outputs transmitter (2-wire) version: 14...36 V DC, filtered and regulated • 4 outputs transmitter (3-wire) version: 12...36 V DC, filtered and regulated <p>Connection to main supply: permanent (through external SELV (Safety Extra Low Voltage) and LPS (Limited Power Source) power supply</p>
Current consumption	<p>With sensor</p> <ul style="list-style-type: none"> • ≤1 A (with transistors load) • 3 outputs transmitter (2-wire) version: ≤25 mA (at 14 V DC without transistors load, with current loop) • 4 outputs transmitter (3-wire) version: ≤5 mA (at 12 V DC without transistors load, without current loop)
Outputs	
Transistor	<ul style="list-style-type: none"> • Adjustable as sourcing or sinking (respectively both as PNP or NPN), open collector • Max. 700 mA • 0.5 A max. per transistor if the 2 transistor outputs are wired • NPN-output: 0.2...36 V DC • PNP-output: Power supply
Current	<p>4...20 mA adjustable as sourcing or sinking (in the same mode as transistor)</p> <ul style="list-style-type: none"> • Response time (10 %...90 %): 150 ms (standard) • 1 current output (3 outputs transmitter (2-wire) version) Max. loop impedance: 1100 Ω at 36 V DC; 610 Ω at 24 V DC; 180 Ω at 14 V DC • 2 current outputs (4 outputs transmitter (3-wire) version) Max. loop impedance: 1100 Ω at 36 V DC; 610 Ω at 24 V DC; 100 Ω at 12 V DC
Voltage supply cable	<p>For the female M12 connector and/or the male M12 connector (not supplied, to order separately, see chapter “10.5. Ordering chart accessories” on page 19) use a cable</p> <ul style="list-style-type: none"> • Ø 3...6.5 mm • Cross section of wires: max. 0.75 mm²
Process/Port connection & communication	
Electrical connection	<ul style="list-style-type: none"> • 3 outputs transmitter (2-wire) version: 1 x5 pin M12 male fixed connector • 4 outputs transmitter (3-wire) version: 1 x5 pin M12 male and 1 x5 pin M12 female fixed connectors
Approvals and certificates	
Standards	
Degree of protection ^{1.)}	With device wired and M12 cable plug(s) mounted and tightened and cover fully screwed down: IP65, IP67 (according to IEC/EN 60529),
Certificates	FDA declaration of conformity

1.) Not evaluated by UL

1.4. ELEMENT neutrino version



Product properties

Material

Detailed information on the materials can be found in chapter [“3.2. Material specifications”](#) on page 8.

Non wetted parts

Cover	Black PPS
Seals	EPDM
Screws	Stainless steel
Fixed connector/cable gland	PA66
Nut	PVC (PVDF on request)
Temperature compensation	<ul style="list-style-type: none"> • None or • According to a predefined graph <ul style="list-style-type: none"> – NaCl or – Ultra pure water (only with C=0.01)

Product accessories

Display/configuration module	No
------------------------------	----

Electrical data

Operating voltage	12...36 V DC, filtered and regulated Connection to main supply: permanent (through external SELV (Safety Extra Low Voltage) and LPS (Limited Power Source) power supply)
Current consumption	≤25 mA (with sensor)

Outputs

Current	4...20 mA <ul style="list-style-type: none"> • Response time (10 %...90 %): 5 s (standard) • Max. loop impedance: 1100 Ω at 36 V DC; 610 Ω at 24 V DC; 100 Ω at 12 V DC
Voltage supply cable	<ul style="list-style-type: none"> • For the female M12 connector and/or the male M12 connector (not supplied, to order separately, see chapter “10.5. Ordering chart accessories” on page 19) use a cable <ul style="list-style-type: none"> – Ø 3...6.5 mm – Cross section of wires: max. 0.75 mm² • For terminal strip via a cable gland (measuring data acc. to CEI 664-1/VDE 0110 (4.97 use a cable): <ul style="list-style-type: none"> – Solid H05(07) V-U: 0.25...1.5 mm² – Flexible H05(07) V-K: 0.25...1.5 mm² – With wire end ferrule: 0.25...1.5 mm² – With plastic collar ferrule: 0.25...0.75 mm² – Diameter: 4...8 mm

Medium data

Fluid temperature	Device with G 3/4" external threaded connection: -20...+100 °C (-4...+212 °F) restricted by the used adaptor Restriction with adaptor S022 in PVC: 0...+50 °C (+32...+122 °F)
-------------------	--

Process/Port connection & communication

Process connection	G 3/4" external threaded for use with Type S022 adaptor See data sheet Type S022 ▶ for more information.
Electrical connection	<ul style="list-style-type: none"> • 1x5 pin free positionable M12 male fixed connector or • Terminal strip via 1x cable gland M16×1.5

Approvals and certificates

Standards

Degree of protection^{1.)}

With device wired and M12 cable plug mounted and tightened or cable gland tightened or obturated and cover properly mounted and secured:

- IP65, IP67 (according to IEC/EN 60529)
- NEMA 4X and NEMA 6P (according to NEMA250) (with device installed on the fitting)
- UL50E

1.) Not evaluated by UL

2. Approvals

2.1. Certification

Note:

The certification listed below must be stated when making enquiries. This is the only way to ensure that the product complies with all required specifications. Not all available devices can be supplied with the certification below.

Certificate	Description
	UL-Recognized for USA and Canada Products are UL-certified products and comply also with the following standards: <ul style="list-style-type: none"> • UL 61010-1 • CAN/CSA-C22.2 No.61010-1
	UL-Listed for USA and Canada Products are UL-listed products and comply also with the following standards: <ul style="list-style-type: none"> • UL 61010-1 • CAN/CSA-C22.2 No.61010-1

2.2. Certificates

Note:

The certificate listed below must be stated when making enquiries. This is the only way to ensure that the product complies with all required specifications. Not all available devices can be supplied with the certificate below.

Certificate	Description
FDA	The devices comply in their composition with the Code of Federal Regulations published by the FDA (Food and Drug Administration, USA).
ACS	Certificate of sanitary conformity+ Products comply with the requirements of the circular DGS/SD7A 2002 n° 571 of 25th november 2002.

2.3. Pressure Equipment Directive

The device conforms to Article 4, Paragraph 1 of the Pressure Equipment Directive 2014/68/EU under the following conditions:

Device used on a pipe

Note:

- The data in the table is independent of the chemical compatibility of the material and the fluid.
- PS = maximum admissible pressure, DN = nominal diameter of the pipe

Type of fluid	Conditions
Fluid group 1, Article 4, Paragraph 1.c.i	DN ≤ 25
Fluid group 2, Article 4, Paragraph 1.c.i	DN ≤ 32 or PS*DN ≤ 1000
Fluid group 1, Article 4, Paragraph 1.c.ii	DN ≤ 25 or PS*DN ≤ 2000
Fluid group 2, Article 4, Paragraph 1.c.ii	DN ≤ 200 or PS ≤ 10 or PS*DN ≤ 5000

Device used on a vessel

Note:

- The data in the table is independent of the chemical compatibility of the material and the fluid.
- PS = maximum admissible pressure, V = vessel volume

Type of fluid	Conditions
Fluid group 1, Article 4, Paragraph 1.a.i	$V > 1 \text{ L}$ and $PS \cdot V \leq 25 \text{ bar} \cdot \text{L}$ or $PS \leq 200 \text{ bar}$
Fluid group 2, Article 4, Paragraph 1.a.i	$V > 1 \text{ L}$ and $PS \cdot V \leq 50 \text{ bar} \cdot \text{L}$ or $PS \leq 1000 \text{ bar}$
Fluid group 1, Article 4, Paragraph 1.a.ii	$V > 1 \text{ L}$ and $PS \cdot V \leq 200 \text{ bar} \cdot \text{L}$ or $PS \leq 500 \text{ bar}$
Fluid group 2, Article 4, Paragraph 1.a.ii	$PS > 10 \text{ bar}$ and $PS \cdot V \leq 10000 \text{ bar} \cdot \text{L}$ or $PS \leq 1000 \text{ bar}$

3. Materials

3.1. Chemical Resistance Chart – Bürkert resistApp



Bürkert resistApp – Chemical Resistance Chart

You want to ensure the reliability and durability of the materials in your individual application case? Verify your combination of media and materials on our website or in our resistApp.

[Start Chemical Resistance Check](#)

3.2. Material specifications

ELEMENT standard version



No.	Element	Material
1	Cover	PC
2	Seal	Silicone
3	Fixed connector (female /male M12)	Nickel-plated brass
4	Housing (top)	PPS
5	Fixed connector holder	PPS CF30
6	Seal	EPDM
7	Screws	Stainless steel 1.4301 (304 (A2))
8	Grounding terminal and screw	Stainless steel 1.4401 (316 (A4))
9	Housing (body)	Stainless steel 1.4404 (316L)
10	Seal	EPDM
11	Housing (base)	PPS
12	Probe holder	PVDF
13	Union nuts	PVC or PVDF
14	Pt probe ($C = 1 \text{ cm}^{-1}$)	Stainless steel 1.4571 (316Ti)
15	Electrode ($C = 1 \text{ cm}^{-1}$)	Graphite
16	Pt Probe, electrode ($C = 0.1$ or 0.01 cm^{-1})	Stainless steel 1.4571 (316Ti)

e.g. conductivity meter with a cell constant $C = 1 \text{ cm}^{-1}$

e.g. conductivity meter with a cell constant $C = 0.1$ or $C = 0.01 \text{ cm}^{-1}$

DTS 1000114221 EN Version: O Status: RL (released | freigegeben | validé) printed: 11.10.2021

ELEMENT neutrino version

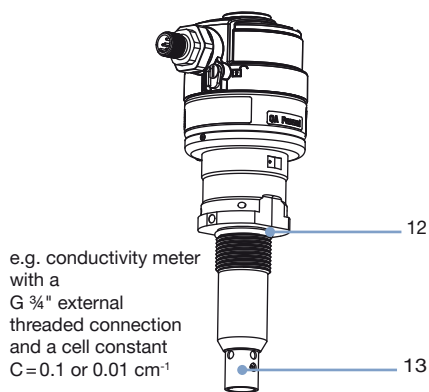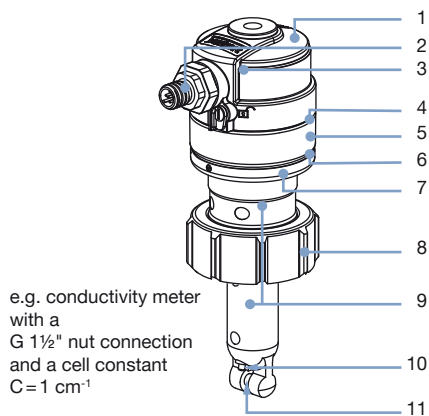


No.	Element	Material
1	Cover	Black PPS
2	M12 fixed connector/cable gland	PA66
3	Seal	EPDM
4	Seal	EPDM
5	Housing (body)	Stainless steel 1.4404 (316 L)
6	Seal	EPDM
7	Housing (base)	PPS
8	Union nuts	PVC (or PVDF on request)
9	Probe holder	PVDF
10	Pt probe (C= 1 cm ⁻¹)	Stainless steel 1.4571 (316Ti)
11	Electrode (C= 1 cm ⁻¹)	Graphite
12	Seal	EPDM
13	Pt Probe, electrode (c= 0.1 or 0.01 cm ⁻¹)	Stainless steel 1.4571 (316Ti)

4. Dimensions

4.1. ELEMENT standard version

Note:

Specifications in mm

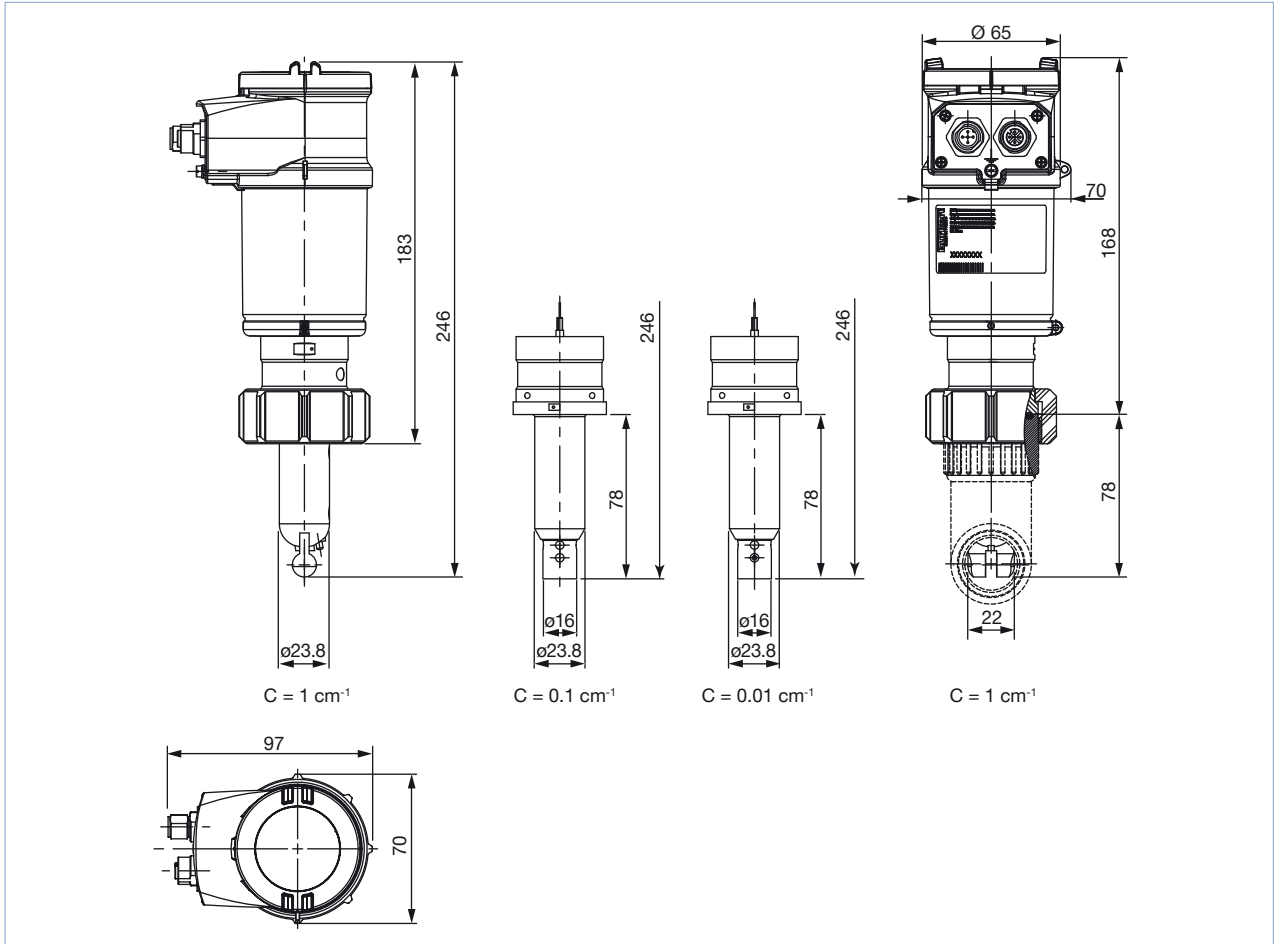


4.2. ELEMENT neutrino version

With a G 1½" union nut connection

Note:


Specifications in mm

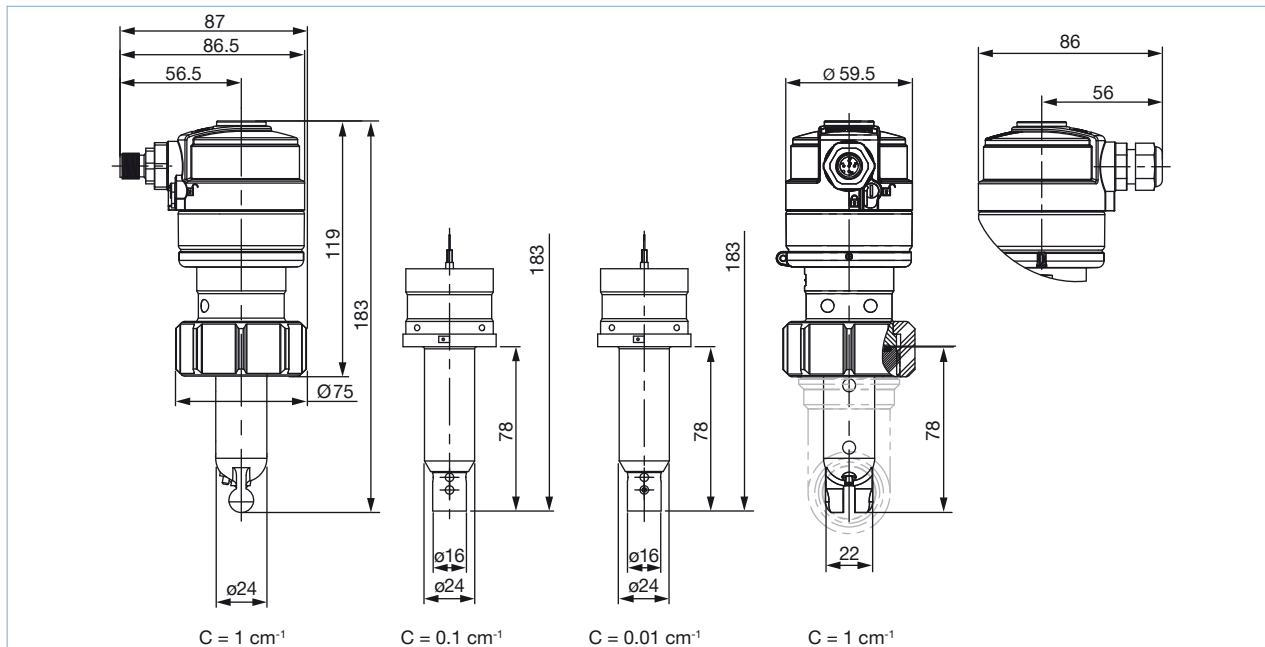

With a G ¾" external threaded connection

Note:

Specifications in mm

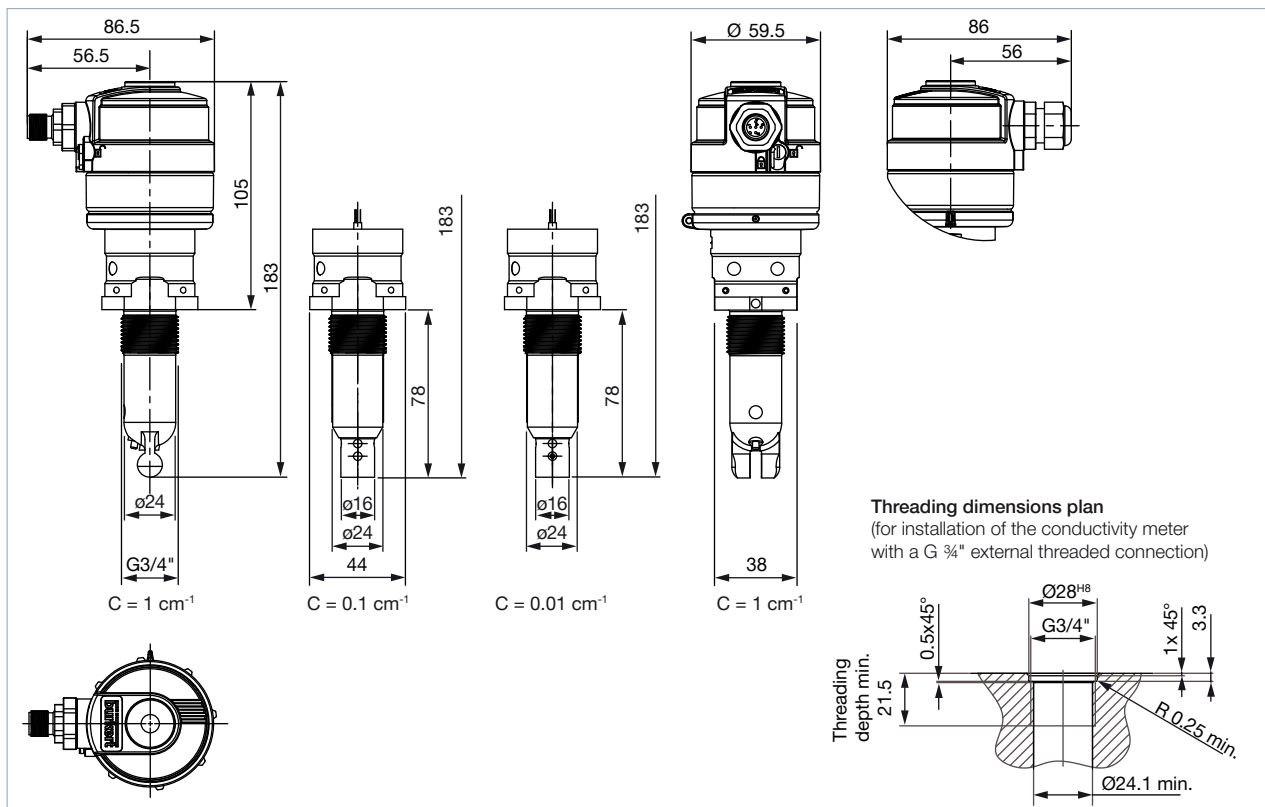


DTS 1000114221 EN Version: O Status: RL (released | freigegeben | valide) printed: 11.10.2021

5. Performance specifications

5.1. Pressure temperature diagram

ELEMENT standard and ELEMENT neutrino versions


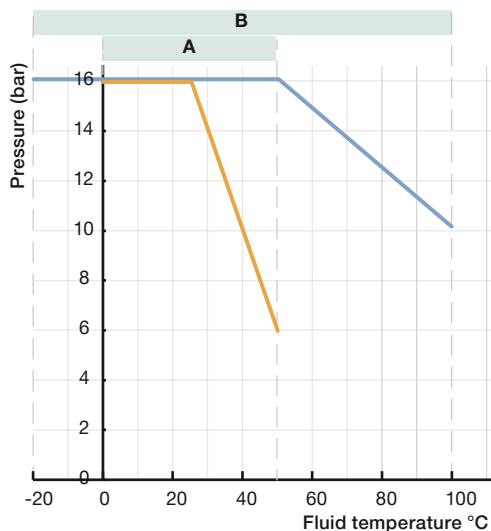


Application range of 8222 ELEMENT standard and neutrino versions
 A: device with PVC union nut
 B: device with
 - a PVDF union nut connection
 (on request for ELEMENT neutrino version) or
 - with a G 3/4" external threaded connection
 (only for ELEMENT neutrino version)

The measures have been made at an ambient temperature of 60 °C


— PVDF — PVC

ELEMENT standard and ELEMENT neutrino versions installed with an S022 adaptor

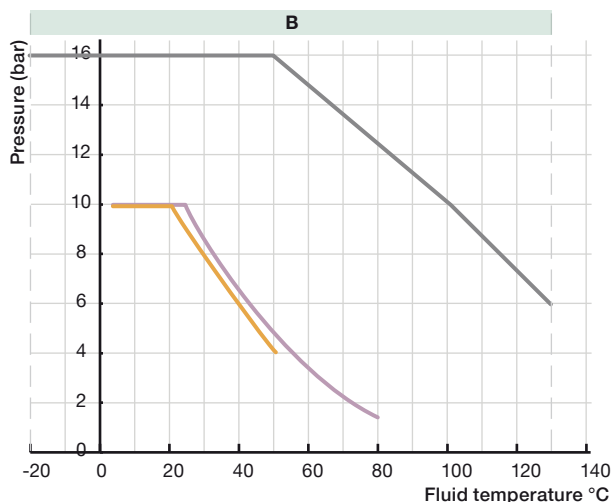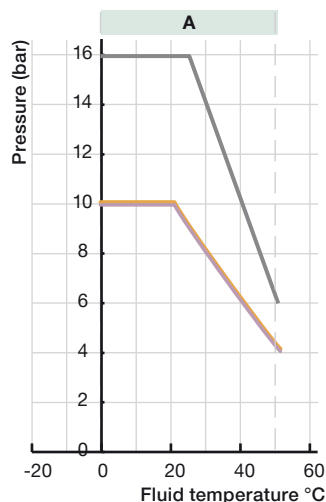

Application range of 8222 ELEMENT standard and neutrino version with S022 adaptor,
 A: device with PVC union nut
 B: device with PVDF union nut
 (on request, for ELEMENT neutrino version)
 C: device with a G 3/4" external threaded connection
 (only for ELEMENT neutrino version)

— PVC — PP — Metal

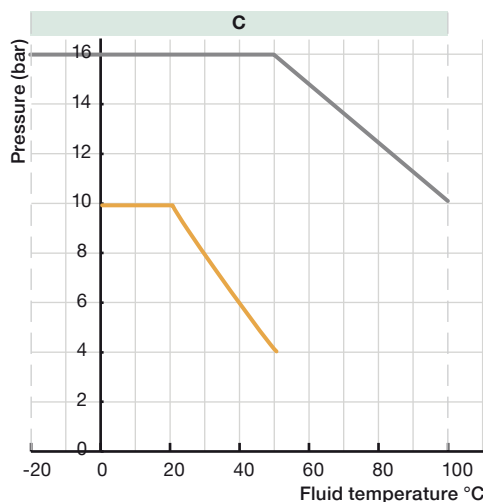

DTS 1000114221 EN Version: O Status: RL (released | freigegeben | valide) printed: 11.10.2021

6. Product installation

6.1. Installation notes

The 8222 ELEMENT standard or neutrino conductivity meter can be installed into any adaptor with G 1½" external threaded sensor connection by just fixing the main union nut. The ELEMENT neutrino conductivity meter with G ¾" external threaded connection can be installed into any adaptor with G ¾" internal threaded (detailed information on threading dimensions plan can be found in chapter "With a G ¾" external threaded connection" on page 11).

Select and install the required adaptor onto the pipe according to specific requirements of the sensor and material (temperature and pressure). For a mounting on a tank or a direct mounting on a pipe (DN 100 or DN 110), an adaptor with a G 1½" external threaded sensor connection or with a G ¾" internal threaded sensor connection (depending on conductivity meter version) must be installed.


See **data sheet Type S022** ▶ for more information about adaptor.

Install cautiously the device on the fitting. It can be installed in any position (**prefer "A" mounting to install a 8222 neutrino with sensor C=0.1 or C=0.01 cm⁻¹**).


In order obtain reliable measurements air bubbles must be avoided.

Please ensure that the mounting location provides a continuous and complete immersion of the probe in the flow stream.

ELEMENT standard version

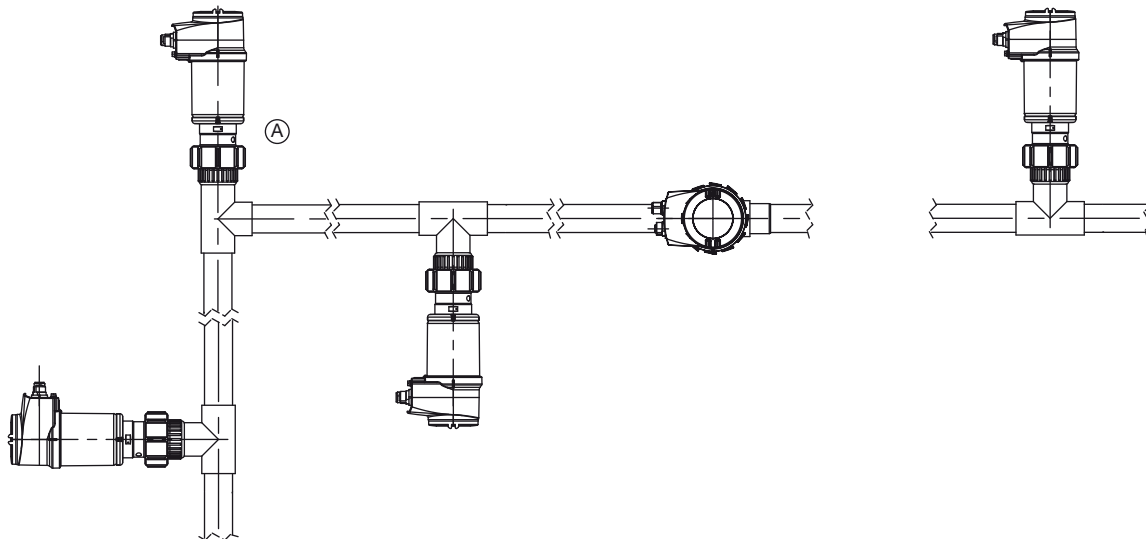

ELEMENT neutrino version

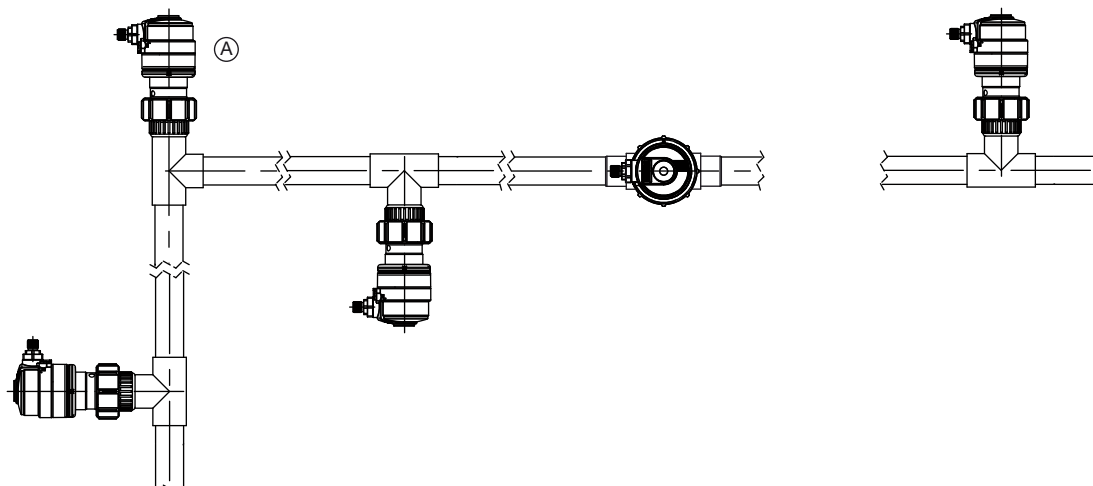

The device must be protected from constant heat radiation and other environmental influences, such as direct exposure to sunlight.


7. Product operation

7.1. Measuring principle


Conductivity is defined by the property of a solution to conduct electrical current. The charge carriers are ions (e.g. dissolved salts or acids). In the case of this device, the measurement cell consists of two electrodes which are set at a fixed distance apart and with a known specified surface. The measured current is a direct function of the quantity of ions contained in the solution, and with help of Ohm's law the conductivity is calculated.

There are countless types of conductivity probes whose measurement values vary by a great margin - depending on the electrode assembly. To compensate for the geometry of the conductivity cell a cell constant is used: $\text{Conductivity [S/cm]} = \text{Measurement [S]} \times \text{Cell constant [1/cm]}$.

The conductivity transmitter can be fitted with 3 different measuring cells with constants $C=0.01$; 0.1 and 1.0 cm^{-1} .

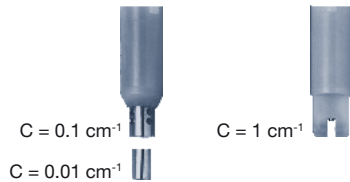

The sensor is selected according to the measuring range and medium by using the table below.

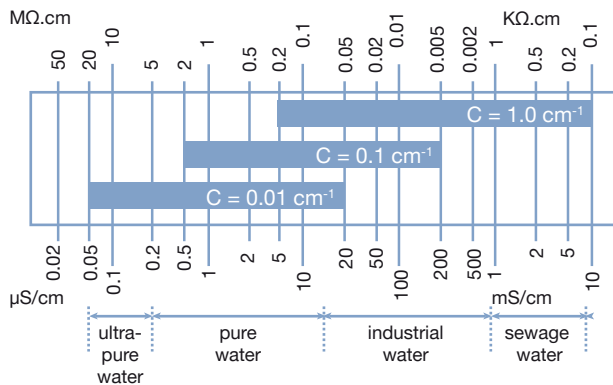

The meter is either a two wire device (3 outputs transmitter ELEMENT standard version or ELEMENT neutrino version) or a three wire device (4 outputs transmitter ELEMENT standard version) which requires a power supply of 14 V DC (3 outputs transmitter ELEMENT standard version) or 12 V DC (4 outputs transmitter ELEMENT standard version or ELEMENT neutrino version) up to 36 V DC and delivers a 4...20 mA standard signal proportional to the conductivity and/or to the temperature of the fluid as output signal.

The measurement range on which the 4...20 mA output must match is selectable for

- the ELEMENT standard version through a display/configuration module and
- the ELEMENT neutrino version through a rotary switch. This measurement range can also be customized on request (contact your nearest Bürkert office).

The electrical connection is provided via one or two M12 fixed connectors for the ELEMENT standard version or via one free positionable M12 male fixed connectors or terminal strip through cable gland for the ELEMENT neutrino version.

8. Product design and assembly

8.1. Product assembly

Note:

The 8222 device can easily be installed into piping systems or vessels by using the S022 adaptor/fitting

- with G 1½" external threaded sensor connection for ELEMENT standard and neutrino version or
- with G ¾" internal threaded connection for only ELEMENT neutrino version.

See **data sheet Type S022** ▶ for more information.

The conductivity meter consists of a sensor available with three different cell constants C, plugged-in and pinned to an enclosure with cover, containing the electronic module. The sensor holder comprises a cell with two electrodes and a Pt1000 temperature sensor.

A removable display/configuration module complements the ELEMENT standard device version. The conductivity meter can operate independently of this module, but it will be required for configuration of the device (i.e. set parameters, restore default parameters, configure information to be displayed, enter access codes, adjust 4...20 mA output(s) ...) and also for visualizing continuously the measured and processed data.

Removable display/configuration module
(separately available)

Conductivity meter Type 8222
ELEMENT standard version


Insertion adaptor Type S022
with G 1½" external threaded sensor connection

Conductivity meter Type 8222
ELEMENT neutrino version

- with G 1½" union nut connection

- with G ¾" external threaded connection

Insertion adaptor Type S022
with G ¾" internal threaded sensor connection

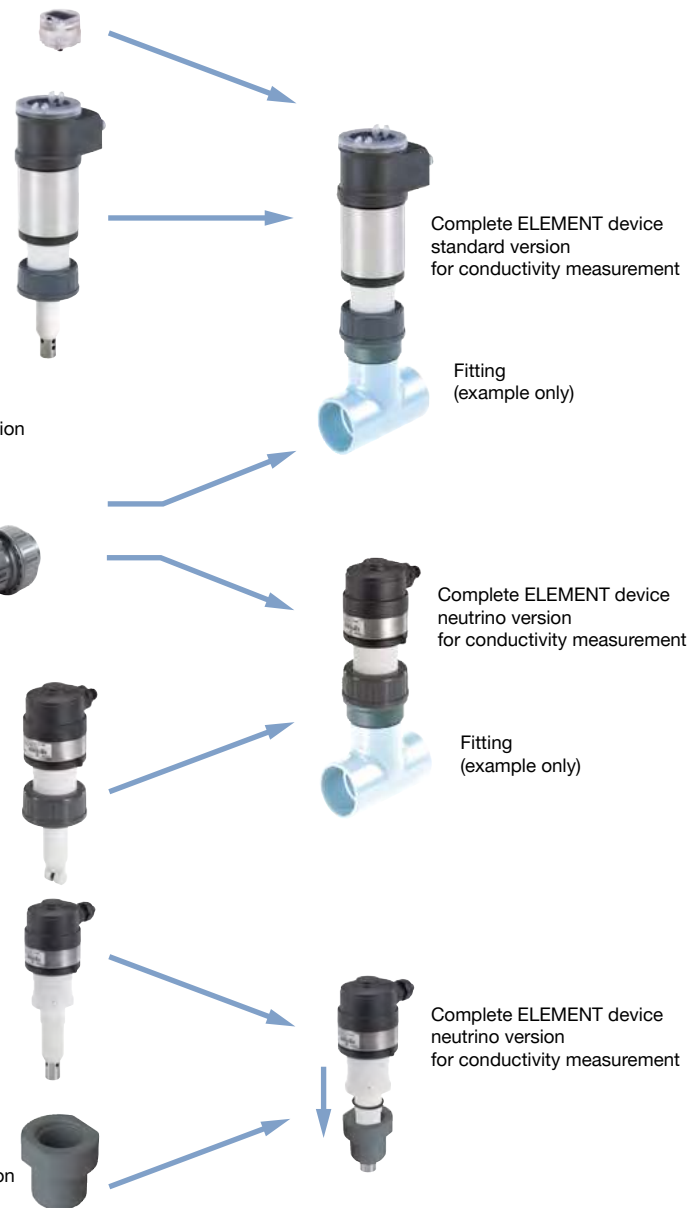

DTS 1000114221 EN Version: O Status: RL (released | freigegeben | valide) printed: 11.10.2021


9. Networking and combination with other Bürkert products

Example:



10. Ordering information

10.1. Bürkert eShop – Easy ordering and quick delivery



Bürkert eShop – Easy ordering and fast delivery

You want to find your desired Bürkert product or spare part quickly and order directly? Our online shop is available for you 24/7. Sign up and enjoy all the benefits.

[Order online now](#)

10.2. Recommendation regarding product selection

Note:

- A complete conductivity measurement equipment consists of an conductivity meter Type 8222 (ELEMENT standard or ELEMENT neutrino version), a removable display/configuration module (only for ELEMENT standard version) and a Bürkert Insertion adaptor Type S022 with a G 1½" external threaded (for ELEMENT standard or ELEMENT neutrino version) or G ¾" internal threaded sensor connection (only for ELEMENT neutrino version).
- When you order a standard version device without display/configuration module, please take care that you also order at least one display/configuration module for parametrising the device (see chapter **"10.5. Ordering chart accessories"** on page 19).


See **data sheet Type S022** ▶ for more information.

Two or three different components must be ordered in order to select a complete device. The following information is required:

- **Article no.** of the desired 8222 conductivity meter ELEMENT standard version without display/configuration module or ELEMENT neutrino version (see chapter **"10.4. Ordering chart"** on page 17)
- **Article no.** of the removable display/configuration module, if necessary for the ELEMENT standard version (see chapter **"10.5. Ordering chart accessories"** on page 19)
- **Article no.** of the selected S022 Insertion adaptor with G 1½" external threaded (for ELEMENT standard or ELEMENT neutrino version with union nut) or G ¾" internal threaded sensor connection (only for ELEMENT neutrino version to be screwed). See **data sheet Type S022** ▶.

Visit product website ▶

10.3. Bürkert product filter



Bürkert product filter – Get quickly to the right product

You want to select products comfortably based on your technical requirements? Use the Bürkert product filter and find suitable articles for your application quickly and easily.

[Try out our product filter](#)

10.4. Ordering chart

ELEMENT standard version

Note:

- All settings as well as the digital output have to be adjusted with the optional available display/configuration module (to be ordered separately).
- All following Article no.s. have a transparent cover as standard and an integrated Pt1000.

Operating voltage	Output	Sensor version	Nut material	UL certification	Electrical connection ^{1.)}	Article no.	
14...36 V DC	3 outputs: 2x transistors NPN/PNP + 1 x 4...20 mA (2 wires)	C = 0.01 cm ⁻¹	PVC	–	5 pin M12 male fixed connector	559618	
				UL-Recognized		562394	
			PVDF	–		559620	
				UL-Recognized		562396	
			C = 0.1 cm ⁻¹	PVC		–	559614
						UL-Recognized	559624
		PVDF		–		559616	
				UL-Recognized		559626	
		C = 1.0 cm ⁻¹	PVC	–		559610	
				UL-Recognized		559638	
			PVDF	–		559612	
				UL-Recognized		559622	
12...36 V DC	4 outputs: 2x transistors NPN/PNP + 2 x 4...20 mA (3 wires)		C = 0.01 cm ⁻¹	PVC	–	5 pin M12 male and 5 pin M12 female fixed connectors	559619
					UL-Recognized		562395
		PVDF		–	559621		
				UL-Recognized	562397		
		C = 0.1 cm ⁻¹		PVC	–		559615
					UL-Recognized		559625
			PVDF	–	559617		
				UL-Recognized	559627		
		C = 1.0 cm ⁻¹	PVC	–	559611		
				UL-Recognized	559639		
			PVDF	–	559613		
				UL-Recognized	559623		

1.) Order separately (see chapter "10.5. Ordering chart accessories" on page 19): M12 cable plugs (only female for one 4...20 mA output, 1 male + 1 female for two 4...20 mA outputs flowmeter)















Further versions on request	
<p>Additional</p> <ul style="list-style-type: none"> • Pre-parameterized devices with configuration: 2- or 4-outputs, filter, temperature compensation, threshold, etc. • With display/configuration module 	<p>Certification and Calibration Calibration certificates</p>

ELEMENT neutrino version

Operating voltage	Output	Sensor version	UL certification	Electrical connection ^{1.)}	Article no.
With a G 1½" union nut connection in PVC					
12...36 V DC	1 × 4...20 mA (2 wires)	C = 0.01 cm ⁻¹	–	5 pin M12 male fixed connector	561661 
			UL-Recognized		562545 
			–	Cable gland	561662 
			UL-Recognized		562546 
		C = 0.1 cm ⁻¹	–	5 pin M12 male fixed connector	561663 
			UL-Recognized		562547 
			–	Cable gland	561664 
			UL-Recognized		562548 
		C = 1.0 cm ⁻¹	–	5 pin M12 male fixed connector	561665 
			UL-Recognized		562549 
			–	Cable gland	561666 
			UL-Recognized		562550 
With a G 1½" union nut connection in PVDF					
12...36 V DC	1 × 4...20 mA (2 wires)	C = 0.01 cm ⁻¹	–	5 pin M12 male fixed connector	562503 
			UL-Recognized		On request
			–	Cable gland	562652 
			UL-Recognized		567396 
		C = 0.1 cm ⁻¹	–	5 pin M12 male fixed connector	562478 
			UL-Recognized		On request
			–	Cable gland	562479 
			UL-Recognized		567357 
		C = 1.0 cm ⁻¹	–	5 pin M12 male fixed connector	562271 
			UL-Recognized		On request
			–	Cable gland	562653 
			UL-Recognized		568024 
With a G ¾" external threaded connection					
12...36 V DC	1 × 4...20 mA (2 wires)	C = 0.01 cm ⁻¹	–	5 pin M12 male fixed connector	561667 
			UL-Recognized		562551 
			–	Cable gland	561668 
			UL-Recognized		562552 
		C = 0.1 cm ⁻¹	–	5 pin M12 male fixed connector	561669 
			UL-Recognized		562553 
			–	Cable gland	561670 
			UL-Recognized		562554 
		C = 1.0 cm ⁻¹	–	5 pin M12 male fixed connector	561671 
			UL-Recognized		562555 
			–	Cable gland	561672 
			UL-Recognized		562556 

1.) Order separately (see chapter "10.5. Ordering chart accessories" on page 19): M12 female cable plug

10.5. Ordering chart accessories

Description	Article no.
For all versions	
Calibration solution, 300 ml, 5 µS/cm	440015 
Calibration solution, 300 ml, 15 µS/cm	440016 
Calibration solution, 300 ml, 100 µS/cm	440017 
Calibration solution, 300 ml, 706 µS/cm	440018 
Calibration solution, 300 ml, 1413 µS/cm	440019 
5 pin M12 female straight cable plug with plastic threaded locking ring, to be wired	917116 
5 pin M12 female straight cable plug moulded on cable (2 m, shielded)	438680 
For ELEMENT standard version	
Removable display/configuration module (with instruction sheet)	559168 
Opaque cover with seal (1 screw cover with EPDM seal + 1 quarter turn closing cover with silicone seal)	560948 
Transparent cover with seal (1 screw cover with EPDM seal + 1 quarter turn closing cover with silicone seal)	561843 
5 pin M12 male straight cable plug with plastic threaded locking ring, to be wired	560946 
5 pin M12 male straight cable plug moulded on cable (2 m, shielded)	559177 
For ELEMENT neutrino version	
EPDM seal for cover/housing sealing	561752 
EPDM seal for conductivity meter with G 3/4" external thread/S022 adaptor sealing ^{1.)}	561955 

1.) Important!

Only use this o-ring to ensure the sealing between the conductivity meter with a G 3/4" external threaded connection and the S022 Insertion adaptor

Bürkert – Close to You

For up-to-date addresses
please visit us at
www.burkert.com

DTS 1000114221 EN Version: O Status: RL (released | freigegeben | validé) printed: 11.10.2021

